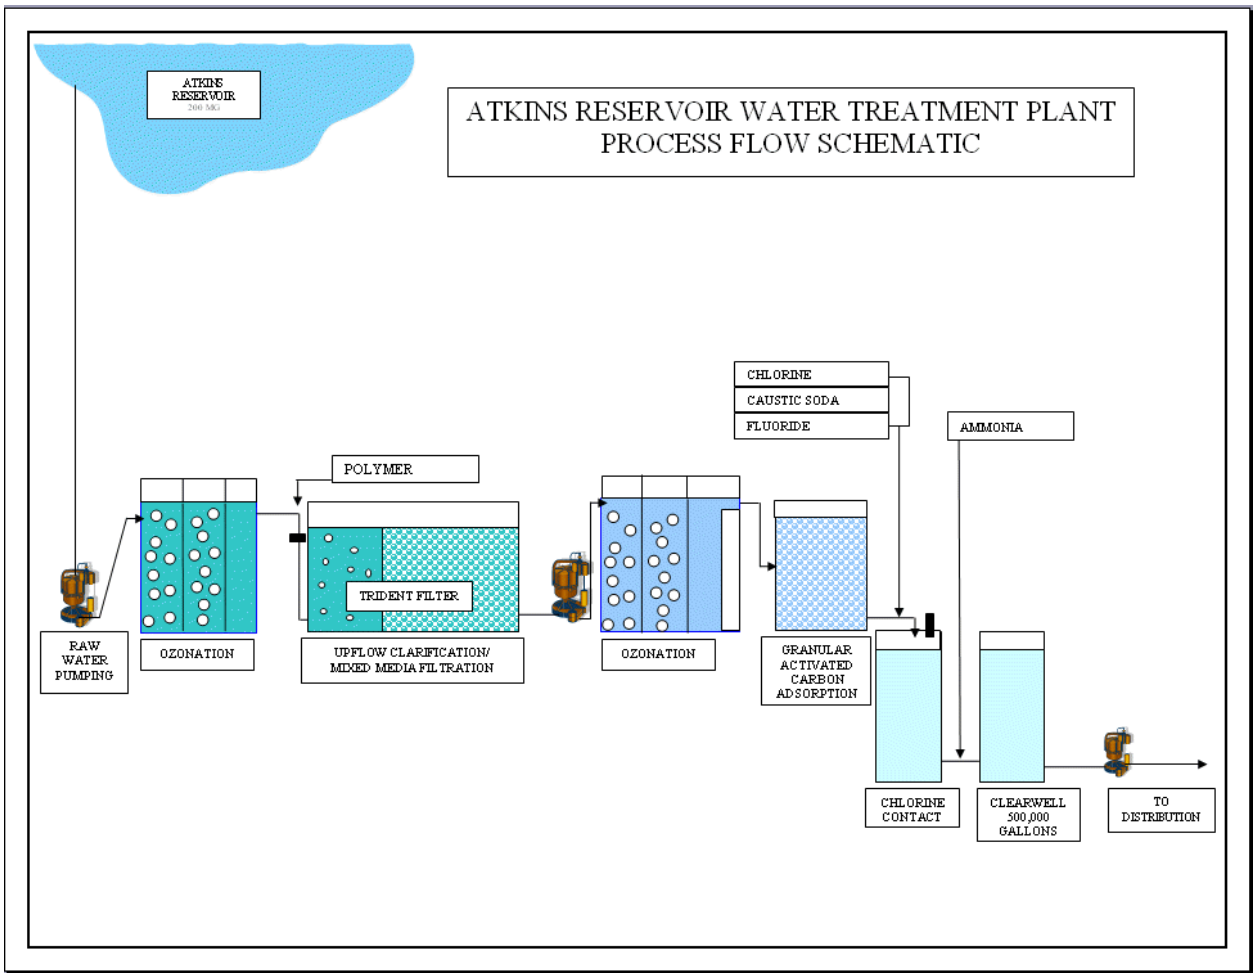
ATKINS RESERVOIR
ATKINS RESERVOIR WATER TREATMENT PLANT
PROCESS FLOW SCHEMATIC
CHLORINE
CAUSTIC SODA
FLUORIDE
AMMONIA
POLYMER
TRIDENT FILTER
RAW WATER PUMPING
OZONATION
UPFLOW CLARIFICATION/ MIXED MEDIA FILTRATION
OZONATION
GRANULAR ACTIVATED CARBON ADSORPTION
CHLORINE CONTACT
CLEARWELL 500,000 GALLONS
TO DISTRIBUTION