


- NOTES:
1. CONCRETE FINISH TO BE MEDIUM TEXTURE BROOM FINISH PERPENDICULAR TO THE DIRECTION OF WALK WITH 2" TROWELED EDGES.
 2. MINIMUM DECORATIVE WALK WIDTH TO BE 8' FROM OUTSIDE OF BRICK TO OUTSIDE OF BRICK EDGES.

DECORATIVE CONCRETE WALK


N.T.S.

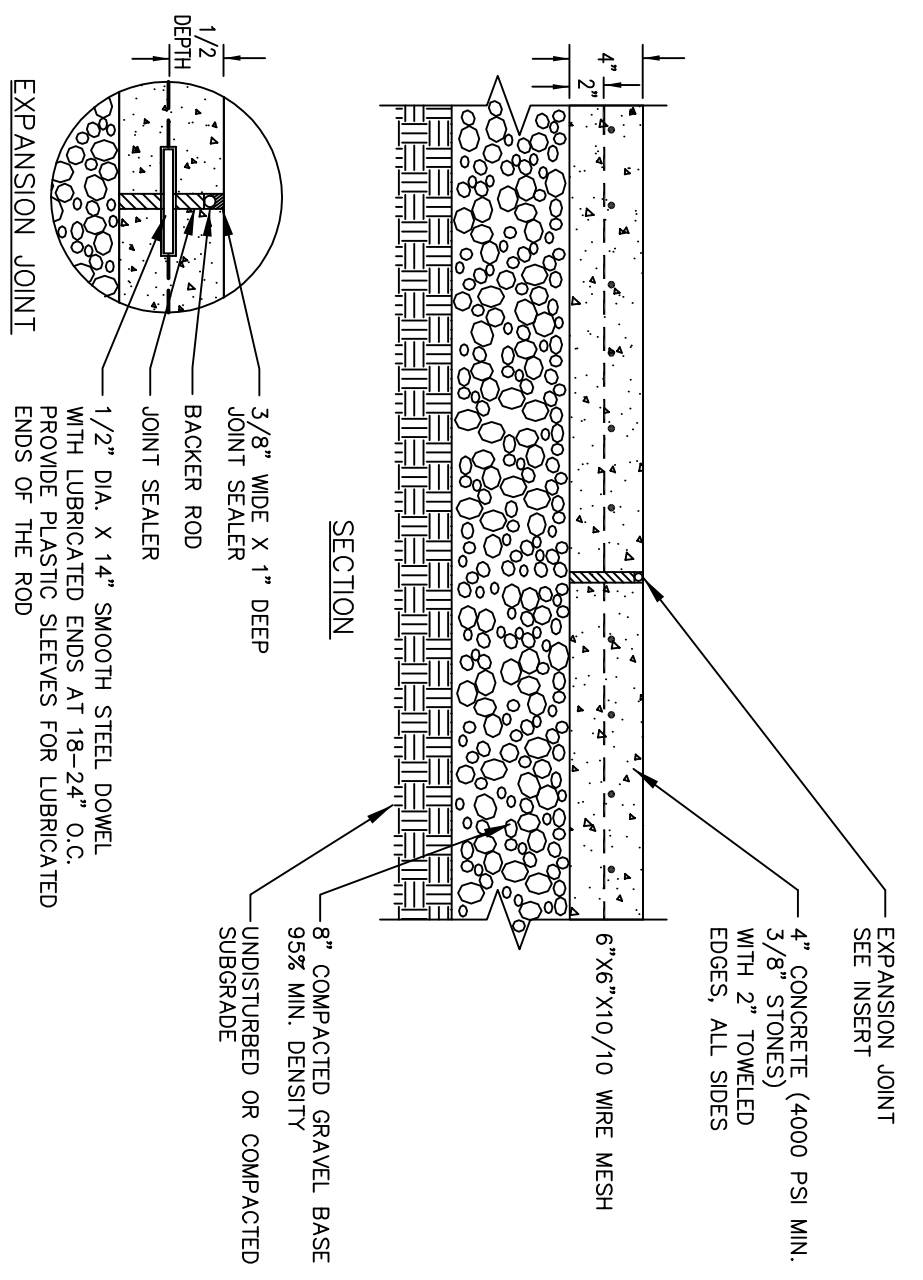

- NOTES:
1. IN UNSUITABLE CONDITIONS ARE ENCOUNTERED DEPTH OF BASE MATERIAL SHALL BE INCREASED.
 2. ALL STEELWALKS SHALL BE CONSTRUCTED TO MEET CURBED ADA HANDICAPPED REQUIREMENTS, MAINTAIN 2% MINIMUM CROSS SLOPE TOWARDS ROADWAY FOR ALL STEELWALKS. STEELWALKS SHALL HAVE A MIN. WIDTH OF 8'.
 3. STEELWALKS SHALL HAVE A MIN. WIDTH OF 8'.
 4. WALKWAY SCORING SHALL BE EVERY 5'. EXPANSION JOINTS PERPENDICULAR TO THE DIRECTION OF WALK WITH 2" TROWELED EDGES.
 5. CONCRETE FINISH TO BE MEDIUM TEXTURE BROOM FINISH PERPENDICULAR TO THE DIRECTION OF WALK WITH 2" TROWELED EDGES.

CONCRETE WALK/EXPANSION JOINT


N.T.S.

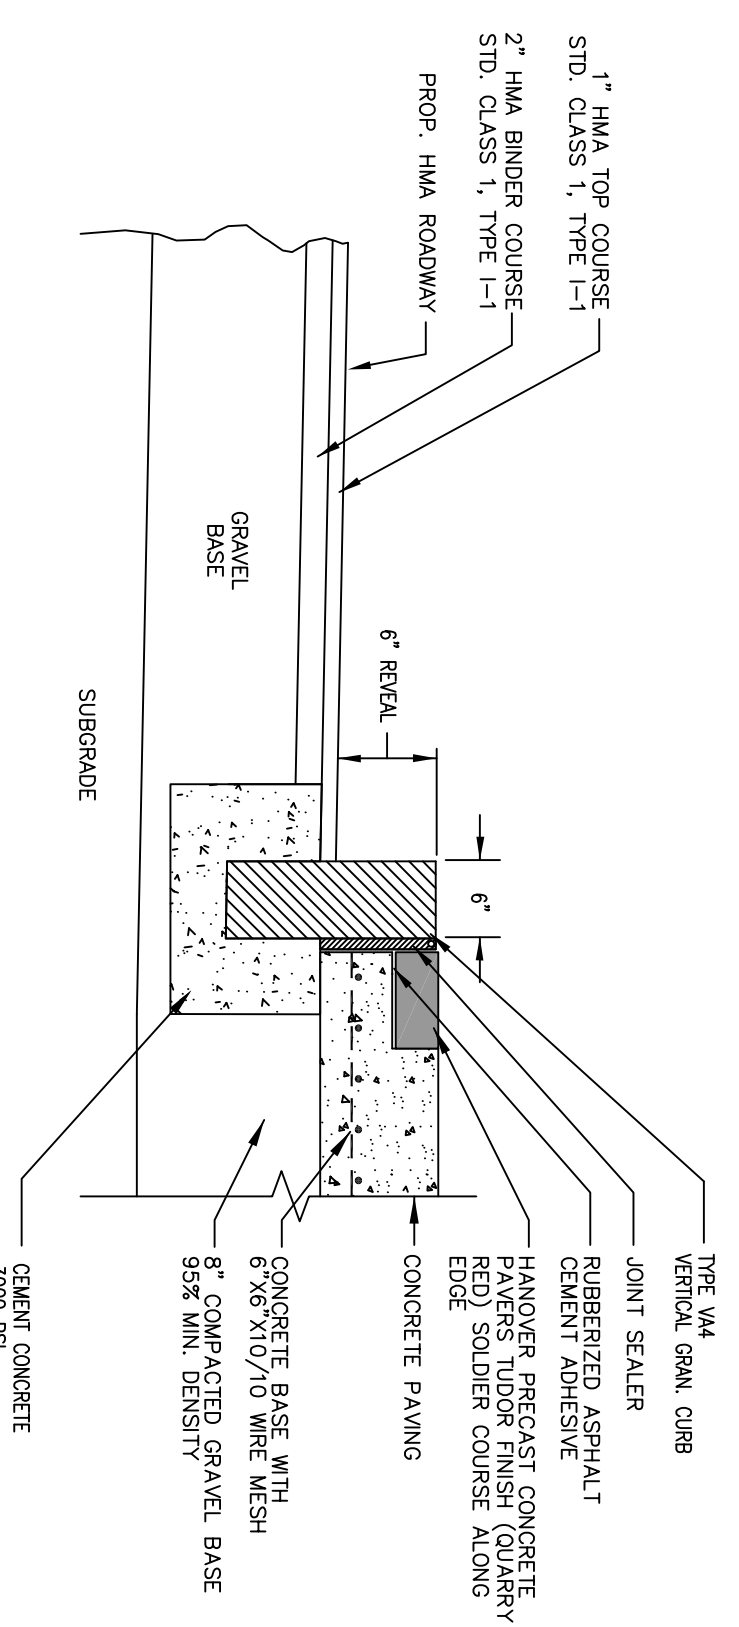

- NOTES:
1. SEE PLAN FOR LOCATION OF 6" REVEAL, FLUSH GRAN. AND TRANSITION GRAN. CURB.


CONCRETE CURB INSTALLATION

N.T.S.

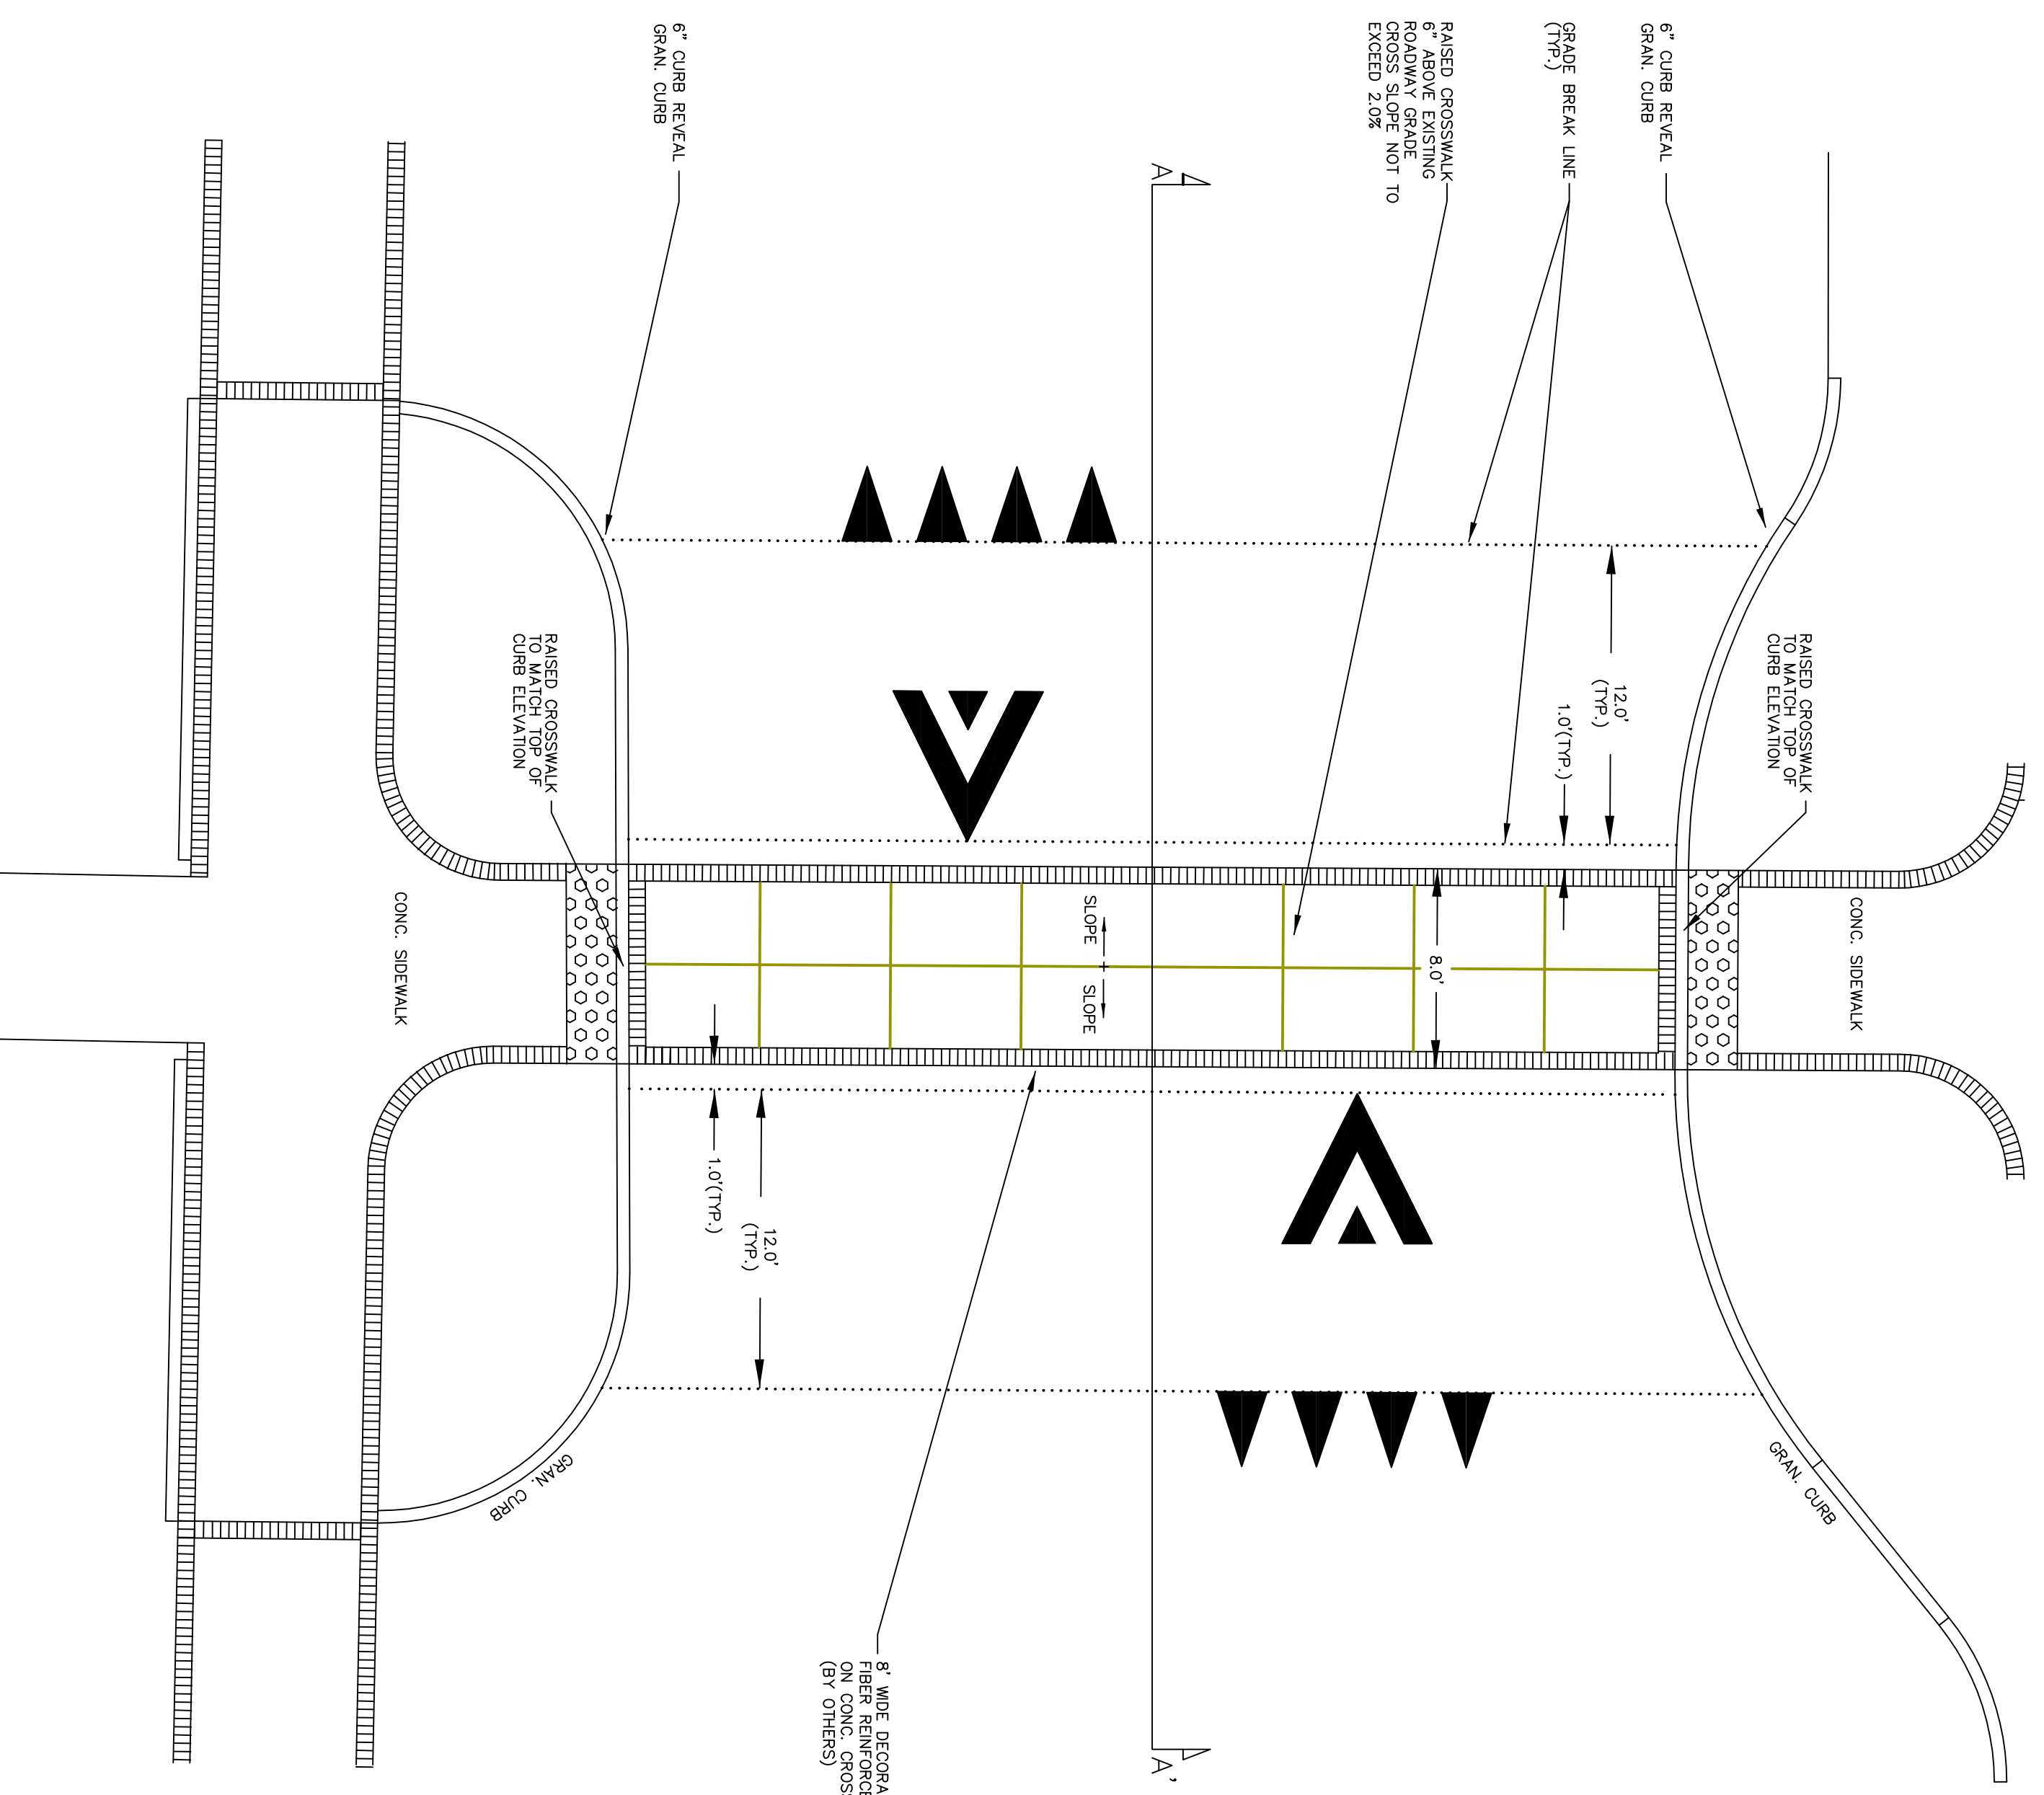

AMITY STREET RAISED CROSSWALK (PLAN VIEW)

N.T.S.

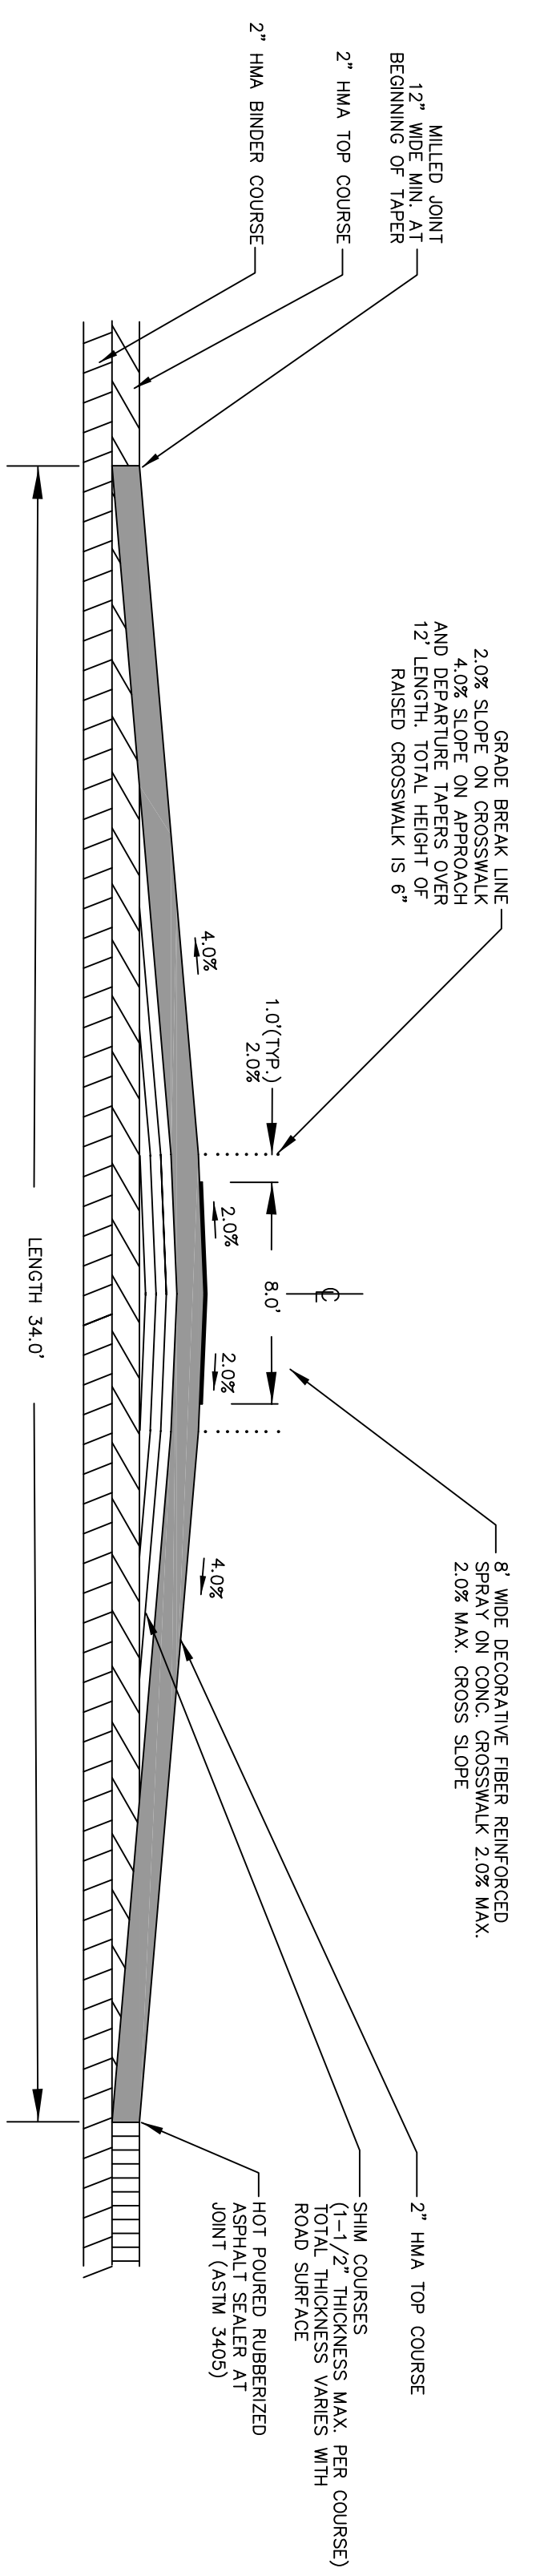

TYPICAL RAISED CROSSWALK SECTION A-A'

N.T.S.



TOWN OF AMHERST
 DEPARTMENT OF PUBLIC WORKS
 ENGINEERING DIVISION
 586 SOUTH PLEASANT STREET
 AMHERST, MA. 01002
 413-259-3029

REV.	DESCRIPTION	BY	DATE

AMITY STREET CROSSWALK IMPROVEMENTS
 AMITY STREET
 AMHERST, MASSACHUSETTS 01002

CONSTRUCTION DETAILS

SHEET: 6 OF 6

DRAWN BY: PGD	CHCKD BY: GBM
SCALE: 1" = 10'	
DATE: JANUARY 2016	
JOB NO.: TP09-09	